PART NO.


EXT ALARM II

**PAGE** 2


PUMP/ALARM POWER CIRCUIT 115V - 1PH

NOTE: BOTH MOTOR MUST HAVE

INTERNAL OVERLOAD PROTECTION.

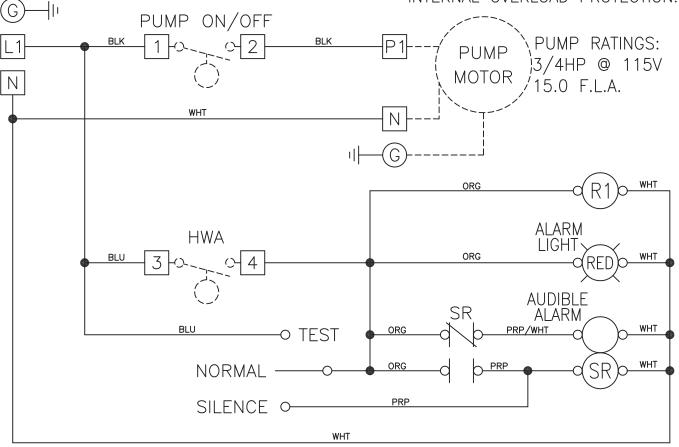

**AUXILIARY CONTACTS** 5A @ 230VAC MAX



NOTES: MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER. DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL. FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE. REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 9 in-lbs.

ALL INFORMATION CONTAINED IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY TO CONFRY MEG

	OCIVITIZE AND THE METALLIANT TO CONTENT WITC.			
	CHANGES	TOLERANCES	DRAWN BY	DATE
	F	DECIMALS .xxx = ±.005	D.M.	8/7/2014
	E D	.XX = ±.003 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X* = ±1/2*	MATERIAL SPECIFICATION:	
	B		AS NOTED	
	AI	\ \ - \pm 1/2		



SCHEMATIC, ELECTRICAL

SCALE: PART NO.

EXT ALARM II **FULL**